

90° SWEEPING BEND

(ABS001/27 - 27mm)

Designed for changing the direction of a pipe run at 90° on an aspirating smoke detection pipe network.

Pipe is designed for aspirating fire detection only.

Installation Instructions:


Use the correct solvent Plusbond 3019. Do not paint.

Keep pipe clean and free from dust.
Do not install in direct sunlight.
Only install with approved pipe.
Do not use solvents to clean,
only soapy water.

Part No. ABS001/27

Pipe colour RED

Diameter Tolerance +/- 0.15mm

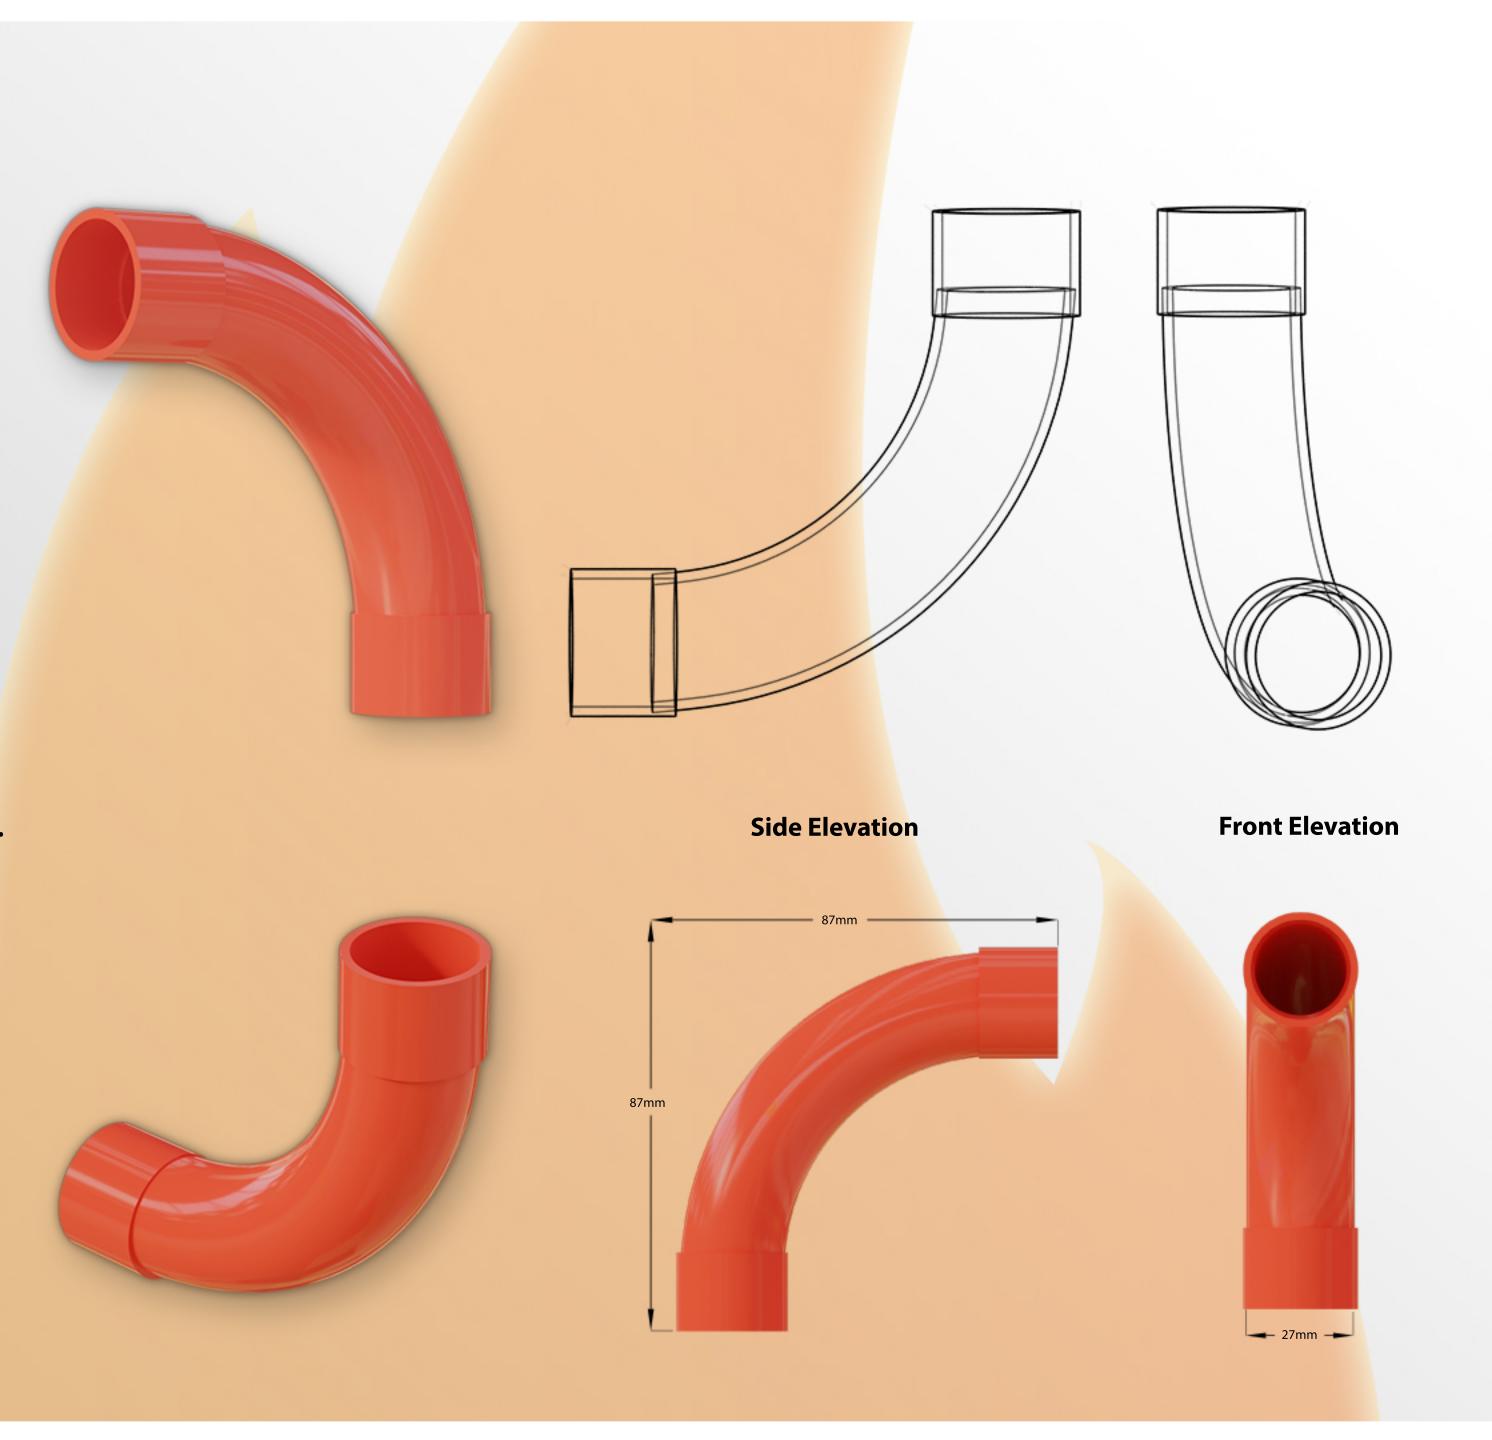

RAW MATERIAL DATA

Kumho ABS 750

Acrylonitrile Butaduene Styrene

Pysical:

Specific Gravity 1.04
Test Method ASTM D792

Melt Mass - Flow Rate (MFR) 200°C/21.6 kg 47 g/10 min 200°C/5.0 kg 4.1 g/10 min 220°C/10.0 kg 34 g/10 min Test Method ASTM D1238

Molding Shrinkage -Flow 0.0040 to 0.0070 in/in Test Method ASTM D955

Mechanical:

Tensile Strength Yield, 73°F (23°C) 1.97 in (50.0mm) 6670 psi Test Method ASTM D638

Tensile Elongation

Yield, 73°F (23°C) 1.97 in (50.0 mm), 15% Test Method ASTM D638

Flexural Modulus

Yield, 73°F (23°C) 0.118 in (3.00 mm) 312000 psi Test Method ASTM D638

Flexural Strength

Yield, 73°F (23°C) 0.118 in (3.00 mm) 9230 psi Test Method ASTM D790

Impact

Noched Izod Impact 73°F(23°C), 0.126 in (3.20 mm), 5.5 ft·lb/ir 73°F(23°C), 0.252 in (6.40 mm), 4.8 ft·lb/ir Test Method ASTM D256

<u> Hardness</u>

Rockwell Hardness (R-Scale) 108 Test Method ASTM D785

Therm

Deflection Temperature Under Load 264 psi (1.8 MPa), Unanneald 185°F/85°C Test Method ASTM D648

Vicat Softening Temperature 203°F/95°C Test Method ASTM D1525

<u>Flamibility</u>

Flame Rating
0.0630 in (1.60 mm) HB
0.0866 in (2.20 mm) HB
0.126 in (3.20 mm) HB
Test Method UL 94

Fire Suppression Limited
Unit 11, Eldonwall Trading Estate,
St.Phillips, Bristol, BS4 3QQ

Tel: 0845-127-9915 Fax: 0845-127-9959 sales@firesuppression.co.uk

©All rights reserved. Fire Suppression Ltd.