

END CAP ADAPTOR

(ABS021 - 25mm)

The capillary end cap is used when it is necessary to sample air not only in the pipe run, but also at the end of the pipe run.

It fits directly onto the end of the 25mm pipe.

There is a 10mm hole in the end cap, which attaches normally to a 10mm OD nylon tube of a pre-determined length to which it is possible to attach either a discrete flush or a conical sampling head.

Installation Instructions:

Use the correct solvent Plusbond 3019.

Do not paint.


Keep pipe clean and free from dust.

Do not install in direct sunlight.

Only install with approved pipe.

Do not use solvents to clean, only soapy water.

Part No.	ABS021 - 25mm
Fitting color	RED
Diameter Tolerance	+/- 0.15mm

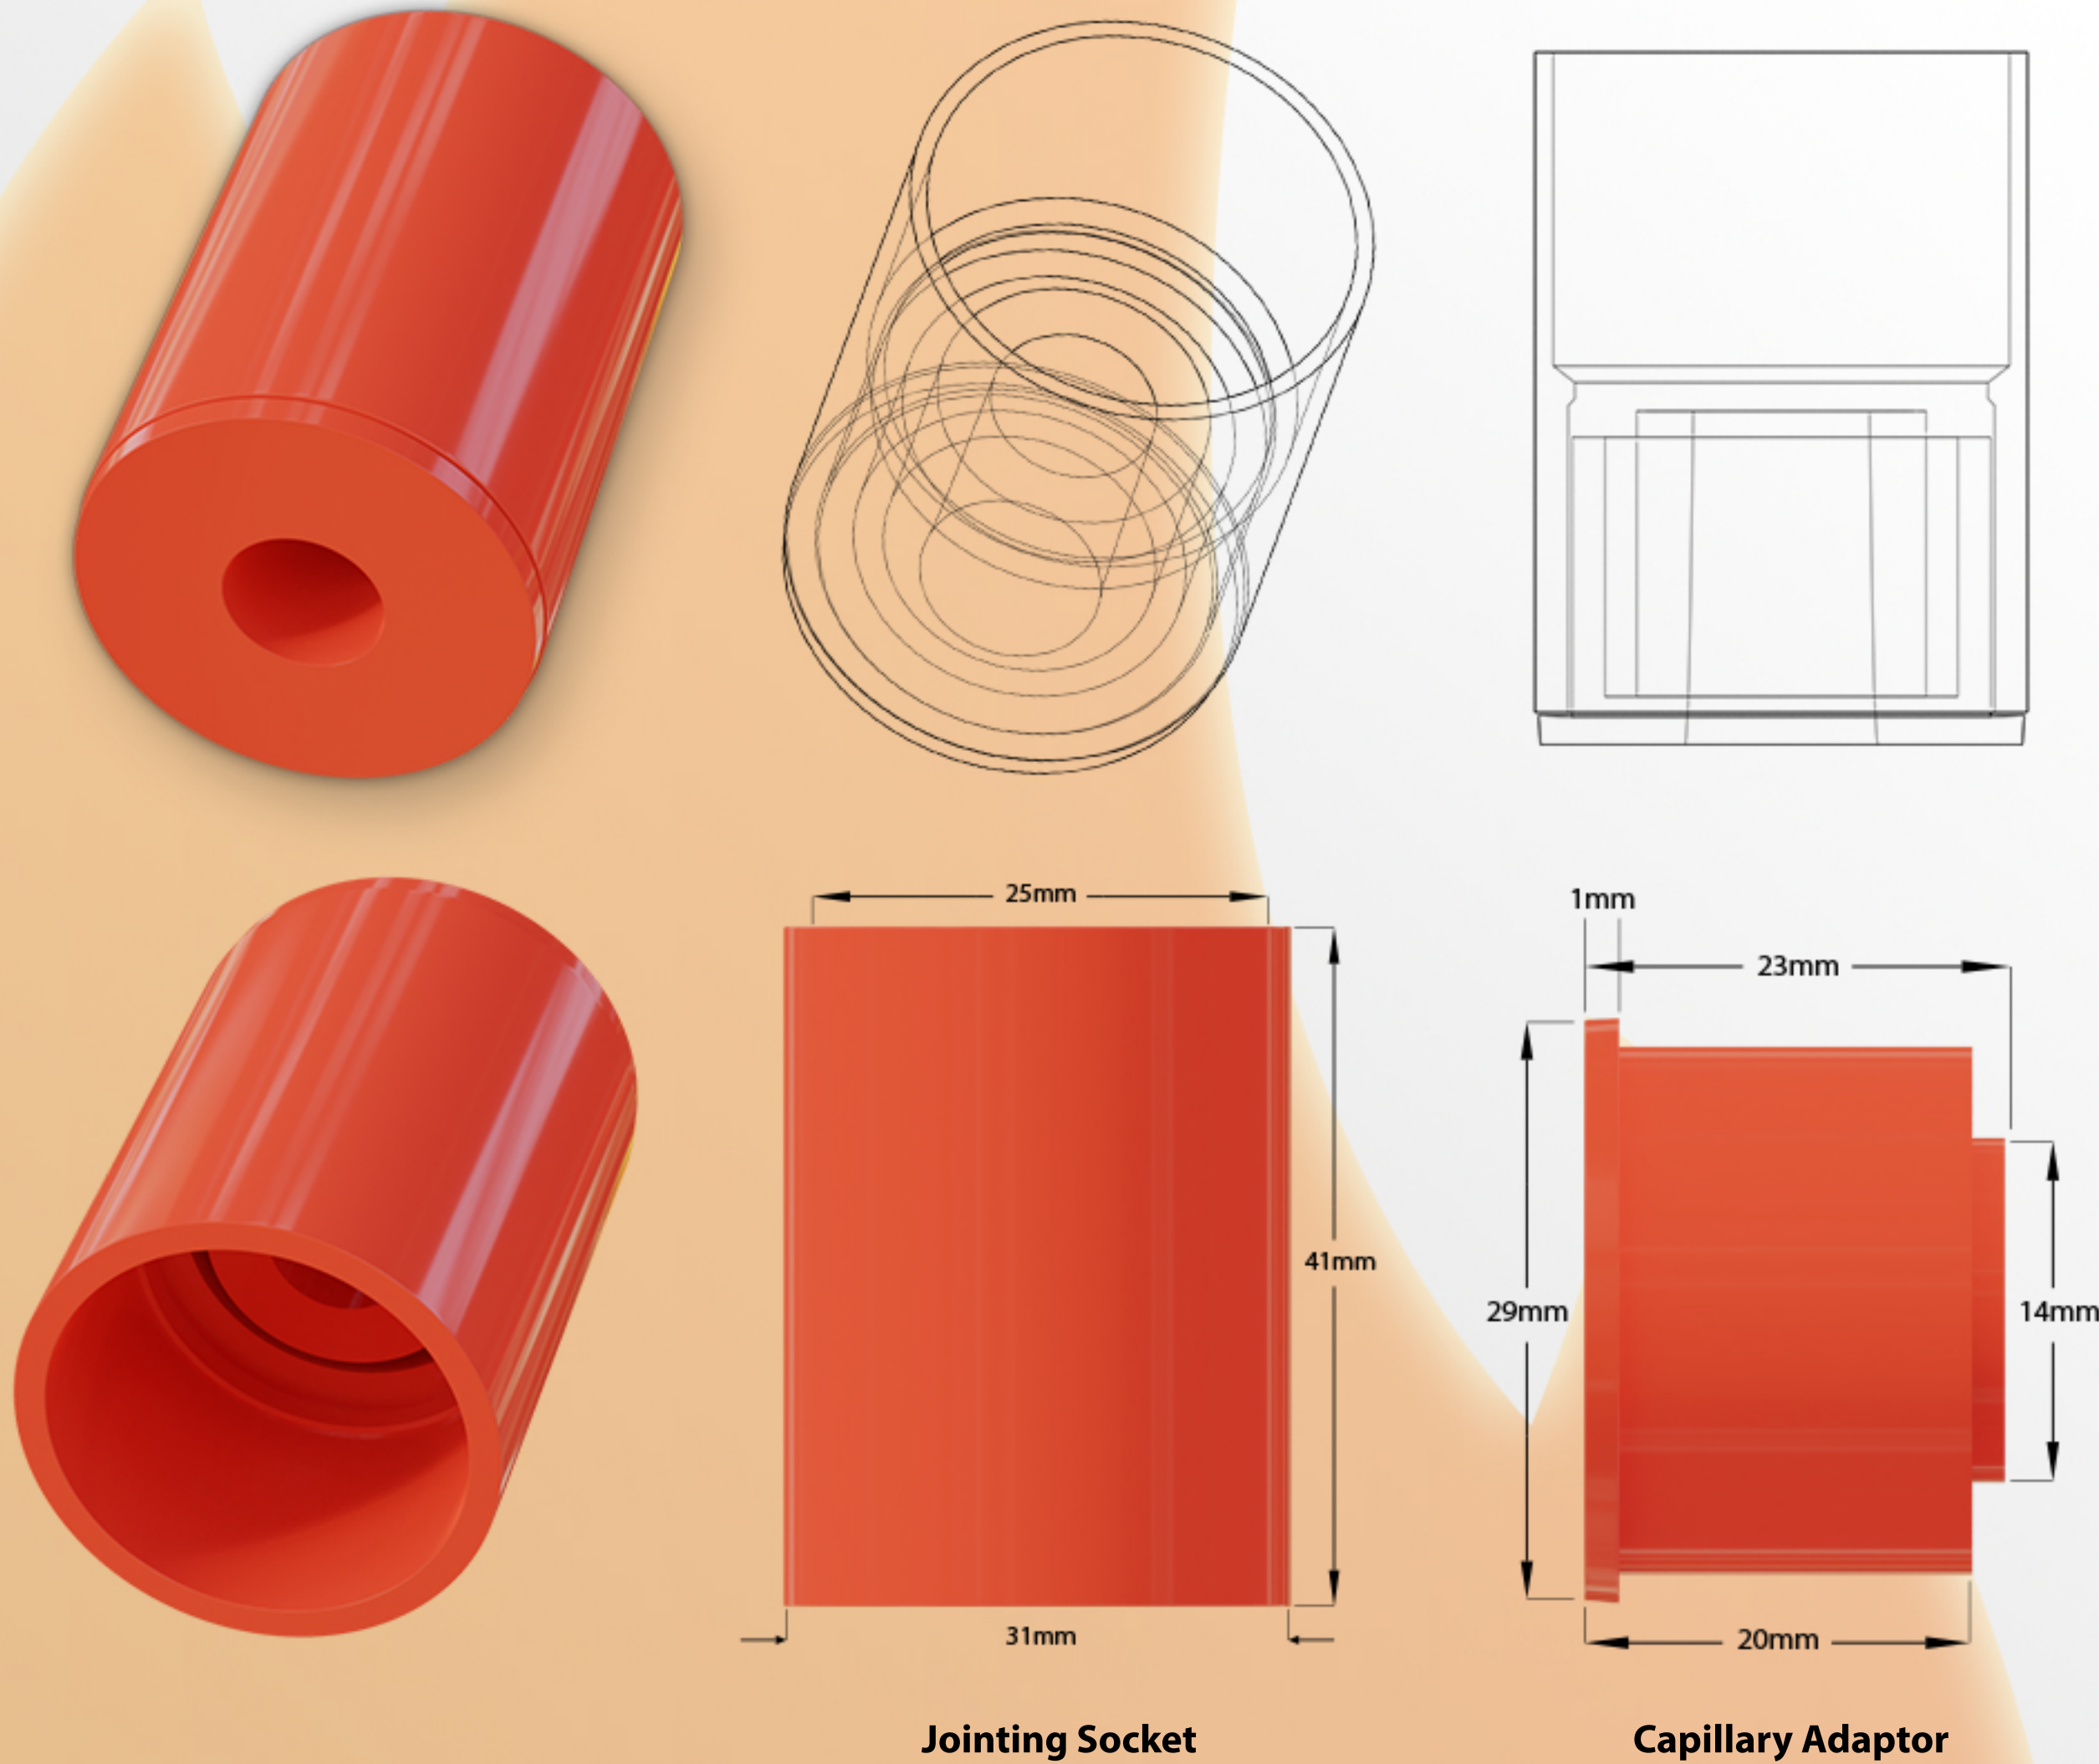

RAW MATERIAL DATA

Kumho ABS 750
Acrylonitrile Butadiene Styrene

Physical:

Specific Gravity 1.04
Test Method ASTM D792

Melt Mass - Flow Rate (MFR)
200°C/21.6 kg 47 g/10 min
200°C/5.0 kg 4.1 g/10 min
220°C/10.0 kg 34 g/10 min
Test Method ASTM D1238

Molding Shrinkage -
Flow 0.0040 to 0.0070 in/in
Test Method ASTM D955

Mechanical:

Tensile Strength
Yield, 73°F (23°C)
1.97 in (50.0mm)
6670 psi
Test Method ASTM D638

Tensile Elongation

Yield, 73°F (23°C)
1.97 in (50.0 mm), 15%
Test Method ASTM D638

Flexural Modulus

Yield, 73°F (23°C)
0.118 in (3.00 mm)
312000 psi
Test Method ASTM D638

Flexural Strength

Yield, 73°F (23°C)
0.118 in (3.00 mm)
9230 psi
Test Method ASTM D790

Impact

Noched Izod Impact
73°F(23°C), 0.126 in (3.20 mm), 5.5 ft-lb/in
73°F(23°C), 0.252 in (6.40 mm), 4.8 ft-lb/in
Test Method ASTM D256

Hardness

Rockwell Hardness (R-Scale) 108
Test Method ASTM D785

Thermal

Deflection Temperature Under Load
264 psi (1.8 MPa), Unanneald 185°F/85°C
Test Method ASTM D648

Vicat Softening Temperature 203°F/95°C
Test Method ASTM D1525

Flamibility

Flame Rating
0.0630 in (1.60 mm) HB
0.0866 in (2.20 mm) HB
0.126 in (3.20 mm) HB
Test Method UL 94

Fire Supression Limited
Unit 11, Eldonwall Trading Estate,
St.Phillips, Bristol, BS4 3QQ

Tel: 0845-127-9915
Fax: 0845-127-9959
sales@firesuppression.co.uk